



This sign is to be mounted on the door outside of the Fire Alarm Control room door as shown.

Sign material shall be constructed of a durable, weather resistant material.

- Letters are 2" in height
- Letters have 1/4" wide brush strokes.
- 1/2" space between rows
- 1/2" space between edge of sign and words.

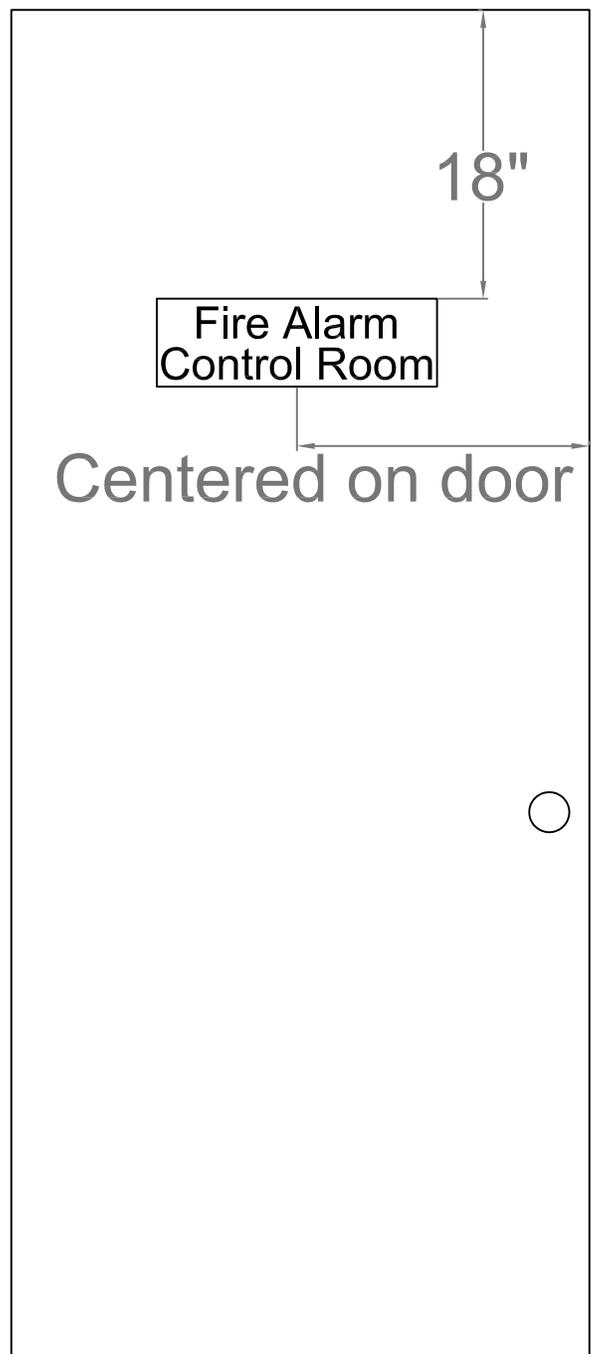

Sign Detail

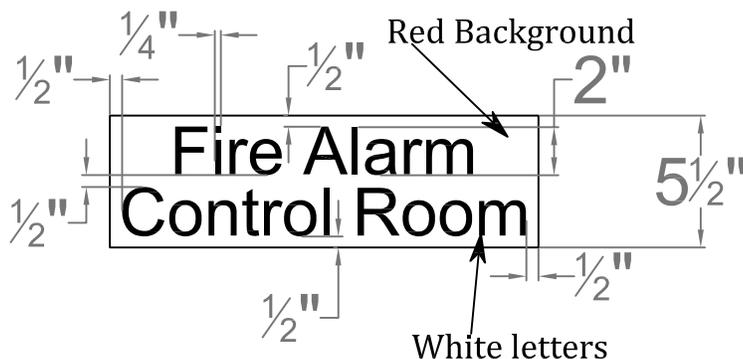

 City of Bothell	City of Bothell <hr/> Community Risk Reduction	Approved By:  Fire Marshal	Fire Alarm Control Room Door Signage	Standard Detail
		Date: July 25, 2012		904
		Revision Date July 2012		